

35MW



35MW

| | | |
|-----------|-------|-----------|
| 1 | | 1 |
| 2 | | 3 |
| 3 | | 5 |
| 4 | | 6 |
| 5 | | 11 |
| 6 | | 19 |
| 7 | | 23 |
| 8 | | 25 |
| 9 | | 30 |
| 10 | | 31 |

“ ”

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

1

| | | | | | |
|-------------|--|---|--|-----------|--|
| 35MW | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| 18813022793 | | / | | 82225 | |
| | | | | | |
| | | | | D4416 | |
| 35MW | | | | | |
| | | | | | |
| | | | | [2015]43 | |
| | | | | 2015.9.25 | |
| | | | | / | |
| | | | | / | |
| | | | | | |
| | | | | [2015]43 | |
| | | | | 2015.9.25 | |
| | | | | / | |
| | | | | / | |
| 45000 | | | | 25 | |
| 45000 | | | | 30 | |
| 45000 | | | | 0.06% | |
| 45000 | | | | 0.067% | |
| 35MW | | | | 2015 9 | |
| 35MW | | | | 2015 12 | |
| / | | | | | |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

| | | | | | |
|------|------|----|------------|------------|------------|
| | | | 35MW | | 2014 |
| | 7 | 2 | | | 35MW |
| | | | " | | [2014]42 " |
| 2015 | 9 | 16 | | | |
| | | | 35MW | | |
| | | | " | [2015]03 " | 2015 9 |
| | | | | | 35MW |
| 2015 | 9 | 25 | | | " |
| | | | [2015]43 " | | |
| | 2015 | 9 | | | 2015 12 |
| | | | | 2019 12 | |
| | | | | | 2020 |
| | 3 | 21 | 3 22 | | 2020 4 03 |
| | | | | | 35MW |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

2

2-1

2-1

5

| | |
|---|--|
| | |
| 1 | |
| 2 | |
| 3 | |
| 4 | |
| 5 | |
| 6 | |
| 7 | |

仅用于“谷达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

3

| | | | | | | | | | | |
|------------|--------------|-----|-------------------|-----------------|-------------------|-------------------|------------------|------|----------------|-----|
| 3-1 | | | | | | | | | | |
| 3-1 | | | | | | | | | | |
| | | | | SO ₂ | PM ₁₀ | PM ₁₀ | NO ₂ | CO | O ₃ | |
| | GB3095-1996 | | | 0.06 | 0.10 | 0.10 | 0.08 | / | / | |
| | | | | 0.15 | 0.15 | 0.15 | 0.12 | 4000 | 160 | |
| | | 1 | | | 0.50 | / | / | 0.24 | 10000 | 200 |
| | GB3838-2002 | III | pH | | COD _{Cr} | | BOD ₅ | | | |
| | | | 6-9 | 20 | | 4 | | 1.0 | | |
| | GB3096-2008 | I | | | | | | | | |
| | | | 55 | | | | 45 | | | |
| | | | mg/m ³ | | | mg/L | | | | |
| dB A | | | | | | | | | | |
| 3-2 | | | | | | | | | | |
| 3-2 | | | | | | | | | | |
| | | | | | COD _{Cr} | BOD ₅ | SS | | | |
| | GB5084-2005 | | | | 200 | 100 | 100 | / | | |
| | | | | | | | | | | |
| | GB16297-1996 | | | | 1.0 | | | | | |
| | | | | | | | | | | |
| | GB18483-2001 | | | | 2.0 | | 60% | | | |
| | | | | | | | | | | |
| | GB12523-2011 | | | / | 70 | | 55 | | | |
| | | | | | | | | | | |
| | GB12348-2008 | | | 1 | 55 | | 45 | | | |
| | | | | | | | | | | |
| | | | mg/L | | | mg/m ³ | | | dB A | |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

4

| | | | | | |
|--------|-------|----------------------------|--------|----------------------------|--|
| | | 35MW | | | |
| | | N29°35 21.23 E115°33 11.93 | | 1300 | |
| | | 740 | | 560 | |
| 1 | | 255Wp | | | |
| 137225 | | 70 | | 500kw | |
| 45000 | | 30 | | 0.067% | |
| 2 | | 4-1 | | | |
| | | 4-1 | | | |
| 1 | 255Wp | 137280 | 137225 | 1650×990×40mm | |
| 2 | 500kw | 70 | 70 | / | |
| 3 | | 35 | 35 | S11-M-1000/35 1MVA 35kv | |
| 3 | | 8 | | | |
| | | 365 | | 24 | |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示


| | | | | |
|-----|--|-----------------------------------|-----------------------------------|----|
| 4-2 | | | | |
| 4-2 | | | | |
| | | 20° | 20° | 55 |
| | | 137280 255Wp 70 500kw 35MWp | 137225 255Wp 70 500kw 35MWp | |
| | | 35 | 35 | -- |
| | | | | -- |
| | | | | -- |
| | | | | -- |
| | | | | -- |
| | | | | -- |
| | | | | -- |
| | | | | -- |

竣工环境保护验收公示

仅用于“台达瑞昌市35MW地面光伏电站项目”

“ “ “ “
“ “

4-1

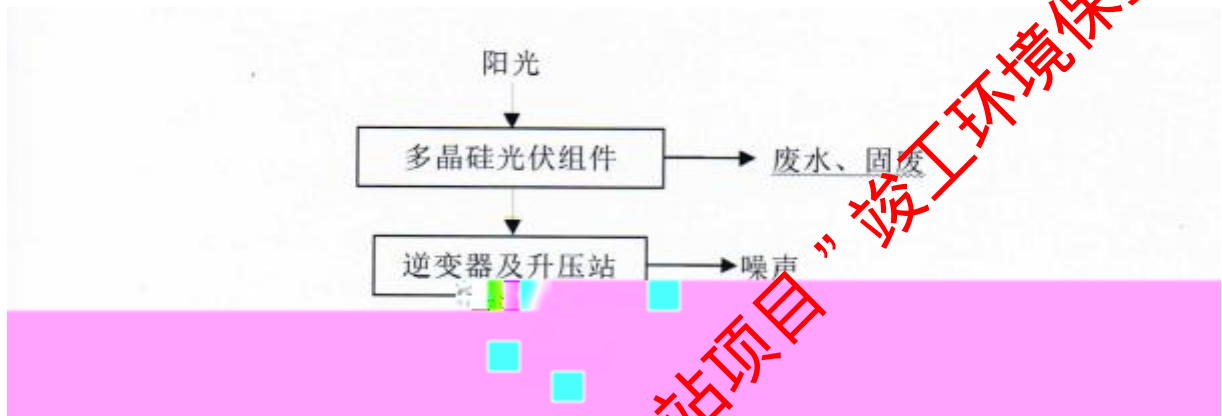

4-1

1300

740

560

4-3

4-3

| | | | | | | |
|--|------|----------------|-----------|-----------|----------|------|
| | | | | | | |
| | | m ² | 866666.67 | 866666.67 | -- | 1300 |
| | | m ² | 600000 | 600000 | -- | 900 |
| | | | | | | 26 |
| | | m ² | 5630 | 7240.04 | -1610.04 | / |
| | | m ² | 900.5 | 893.52 | -6.98 | / |
| | | m ² | 489.2 | 482.52 | -6.68 | / |
| | 35kv | m ² | 384.3 | 384.3 | -- | / |
| | | m ² | 27 | 27 | -- | / |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

| | | | | |
|--------|--|-----|-------|----|
| 0.067% | | 4-4 | 45000 | 30 |
| 4-4 | | | | |
| | | | | 20 |
| | | | | 5 |
| | | | | 2 |
| | | | | 30 |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

| | | | | |
|-----|--|--|------------------------------|---|
| 4-5 | | | | |
| 4-5 | | | | |
| | | | CODcr BOD ₅ SS | |
| | | | TSP | |
| | | | A | |
| | | | | / |
| | | | SS | |
| | | | CODcr BOD ₅ SS | |
| | | | | |
| | | | | / |
| | | | | / |
| | | | | / |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

5

35MW

N29°35'21.23" E115°33'11.93

1300

740

560

4.5

1.

SO₂ NO₂ TSP PM₁₀

1

GB3095-1996

GB3838-2002 III

GB3096-2008)2

2.

1

G

5

6

1300

900

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

1t/a

2008.8.1

104

0.2t

5

COD_{cr} SS NH₃-N

E

| | | | |
|------|--|-----|--------------|
| 2 | | | |
| 3 | | | |
| 0.10 | | | |
| 3. | | | |
| " " | | | |
| 1 | | 21 | |
| | | 21 | |
| | | | GB5084-2005 |
| | | 75% | GB18483-2001 |
| | | | |
| | | | |
| 4. | | | 2011 (2013 |
| | | 1 " | |
| | | | " |
| 5. | | | |
| 6. | | | |
| 1 | | | |

仅用于“谷达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

2

3

"

"

"

"

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

| | | | | | | |
|-------|------|----------|---------|---------|------------------------------|----|
| | | | | | 35MW | |
| | | | | | 35MW | |
| | | | | | N29°35'21.23" E115°33'11.92" | |
| | 1300 | | 560 | | 740 | |
| | | | | 255Wp | 137280 | 70 |
| 500kw | 35 | | | | 45000 | |
| 25 | | 2014 7 2 | | | 35MW | |
| | | | 2014 42 | | 2014 10 10 | |
| | 35MW | | | | 2014 7 3 | |
| | | | | 2014 25 | | |
| | “ | ” | “ | | ” | |
| | | | “ | | | |
| ” | | ” | | | | |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

GB5084-2005

GB12523-2011

GB12348-2008 1

35MW

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

| | | | | | |
|--|--|--|--|---|---|
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | / | / |
| | | | | | |
| | | | | | |
| | | | | | |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

| | | | | | |
|--|--|--|------------------|----------------|----|
| | | | GB12348-2008 1 | GB12348-2008 1 | |
| | | | GB3096-2008 1 | | |
| | | | GB5084-2005 | | |
| | | | | | |
| | | | | | |
| | | | | | 10 |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

| | | | | | |
|--|--|--|------|--|--|
| | | | 0.10 | | |
| | | | / | | |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

GB12348-2008 1

10

“ ” “ ”

“ ”

8

| | | | | |
|-----|----|---------------------------------|----------------------------|-----------------------|
| 1 | | | | |
| 8-1 | | | | |
| | pH | pH GB/T 6920-1986 | pH /FE28-Standard/YQ023 | / |
| | | HJ 828-2017 | / | 4 mg/L |
| | | BOD ₅ HJ 505-2009 | /SPX-150BSH-II/YQ013 | 0.5 mg/L |
| | | HJ 535-2009 | /YQ048 | 0.025 mg/L |
| | | GB/T 11901-1989 | /CPL-4/YQ013 | 4 mg/L |
| | | HJ 637-2018 | /JC-0IL-6/YQ037 | 0.06 mg/L |
| | | A) GB 18483-2001 | /JC-0IL-6/YQ037 | 0.1 mg/m ³ |
| | | GB12348-2008 | /AWA6228+/YQ091 | / |
| 2 | | | | |
| 3 | | | | |
| 1 | | | | |
| 2 | | | | |
| 3 | | | | |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

AWA6228+


 $\pm 0.5\text{dB}$ A

8-2

| | | | dB A | dB A | | |
|--|----------|------|---------|---------|------|--|
| | AWA6221A | 3 21 | 93.8 | 93.9 | 94.0 | |
| | | 3 22 | 93.8 | 93.9 | 94.0 | |

1

| | | | | | | |
|-------------------|----|----|------|--------|------|--------|
| 8-4 | | | | | | |
| GB18483-2001 2 | | | | | | |
| 3 | | | | | | |
| 8-5 (Leq[dB(A)] | | | | | | |
| | | | 03 | 21 | 03 | 22 |
| N1 | 1m | | 42.9 | | 44.8 | 55 |
| | | | 37.6 | | 39.1 | 45 |
| N2 | 1m | | 45.9 | | 45.6 | 55 |
| | | | 37.6 | | 39.5 | 45 |
| N3 | 1m | | 46.4 | | 44.9 | 55 |
| | | | 39.1 | | 37.8 | 45 |
| N4 | 1m | | 45.8 | | 47.1 | 55 |
| | | | 40.3 | | 40.0 | 45 |
| N5 | 1m | | 44.1 | | 45.4 | 55 |
| | | | 35.1 | | 38.2 | 45 |
| N6 | 1m | | 44.7 | | 44.6 | 55 |
| | | | 33.7 | | 39.1 | 45 |
| N7 | 1m | | 46.7 | | 43.2 | 55 |
| | | | 43.4 | | 39.8 | 45 |
| N8 | 1m | | 47.6 | | 42.8 | 55 |
| | | | 35.8 | | 37.6 | 45 |
| | | 03 | 21 | 1.4m/s | 03 | 22 |
| | | | | | | 1.6m/s |
| 8-5 | | | | | | |
| (GB12348-2008) | | | | | | |
| | | | | | | |
| 图例: * 为废水监测点位 | | | | | | |
| 8-1 | | | | | | |
| | | | | | | |
| 图例: "◎" 为食堂油烟采样点位 | | | | | | |
| 8-2 | | | | | | |

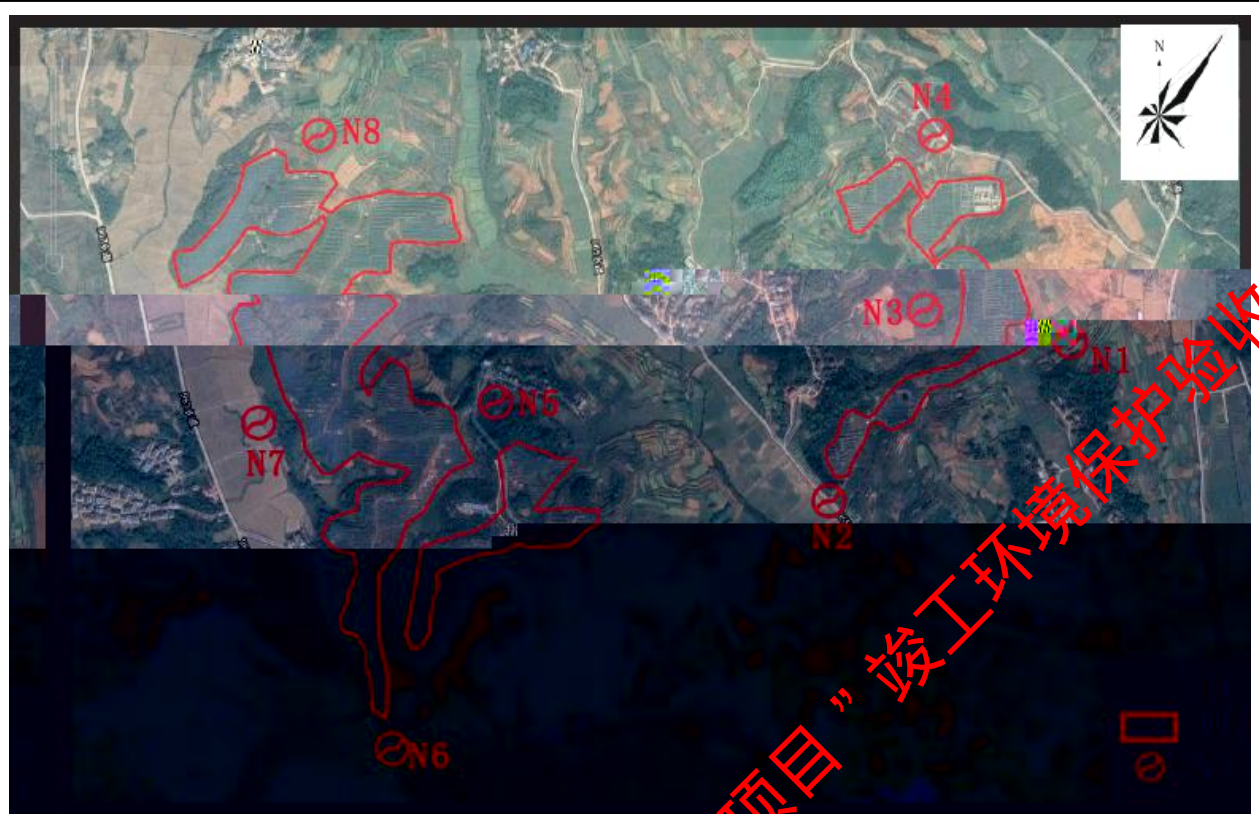

8-3

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

9

| | | |
|-------------|---|--------|
| " | " | 35MW |
| | | |
| | | |
| 1 2 3 | | " " |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

10

| | | | | | |
|---------|------------------|---------------|------|----------|-------------|
| " | 35MW | " | | | |
| | N29°35 21.23 | E115°33 11.93 | | 35MWp | |
| 3722.72 | kW·h | | | | |
| 2014 | 7 | 2 | | 35MW | |
| " | | [2014]42 | " | 2015 | 9 16 |
| | | 35MW | | | |
| " | [2015]03 | " | 2015 | 9 | |
| 35MW | | | | | 2015 |
| 9 | 25 | | " | [2015]43 | " |
| 45000 | | 30 | | 0.067% | 2015 |
| | | | | | |
| | | | | | 35kv |
| 1 | | | | | |
| | | | | | 35kv |
| | | | | | pH |
| CODcr | BOD ₅ | SS | | | GB5084-2005 |

仅用于“台达瑞昌市35MW地面光伏电站项目”竣工环境保护验收公示

913604813092839772